


# Fluke Connect Mobile App How-To: Step-by-step Guide to Setting an Alarm on an Asset


## Step 1:

Log into the Fluke Connect mobile app. Select the three bars on the top left-hand corner to open the side bar.

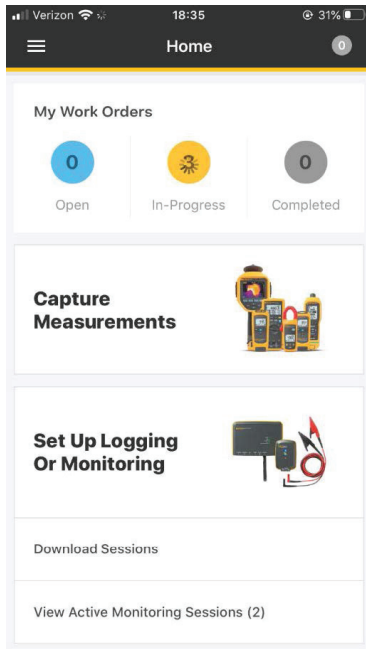


## Step 2:

Select the 'Assets' Tab.

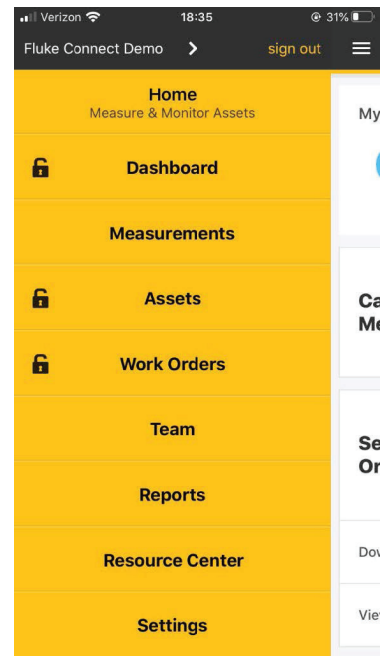


## Step 3:

Select the 'Asset Group' you would like to select your asset from.

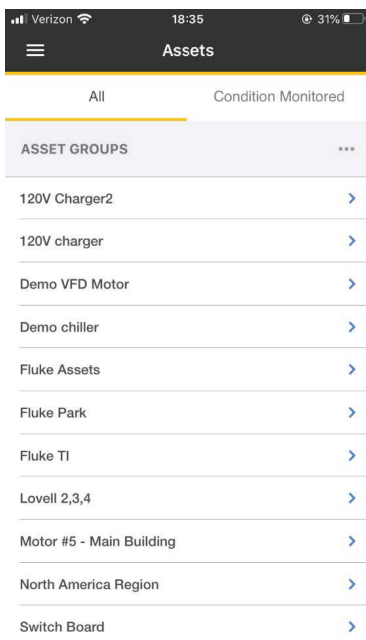


## Step 4:

Select the asset you would like to add your alarms to.

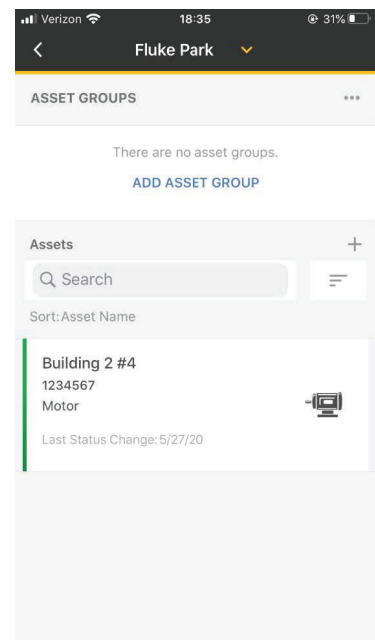


**Step 5:**

Select the plus sign (+) on the 'Alarms' tab towards the bottom of the screen.

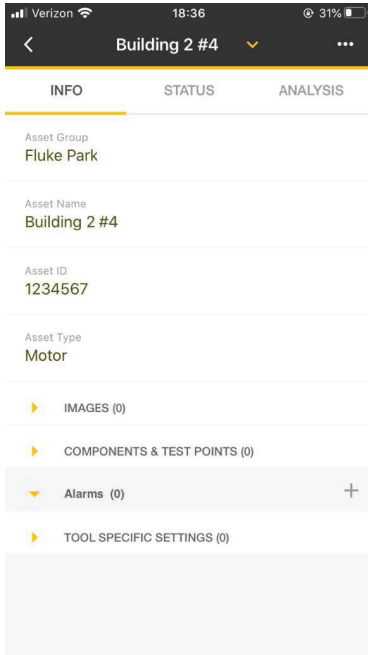


**Step 6:**

Select the type of measurement you would like to add an alarm to.

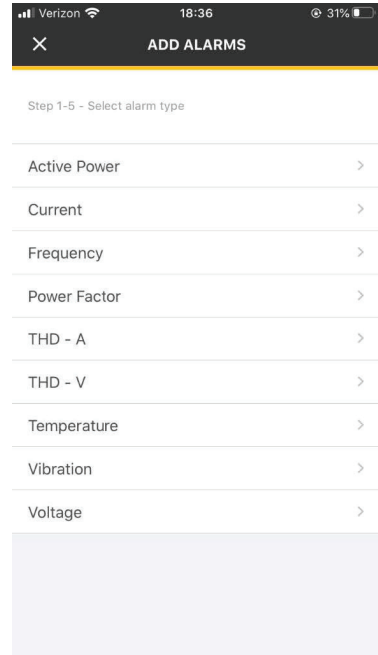


**Step 7:**

Select which limit of the measurement you would like to add an alarm to.

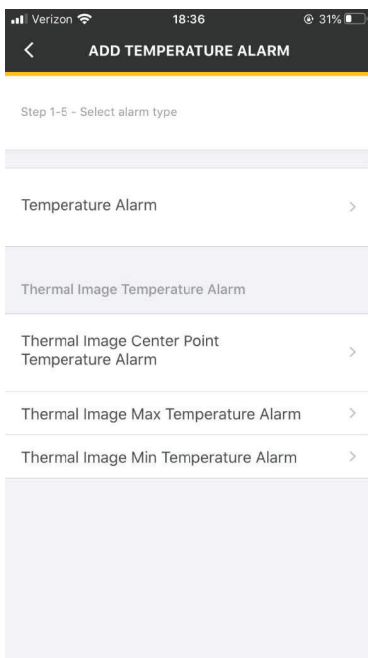


**Step 8:**

Select which limit of the measurement you would like to add an alarm to.

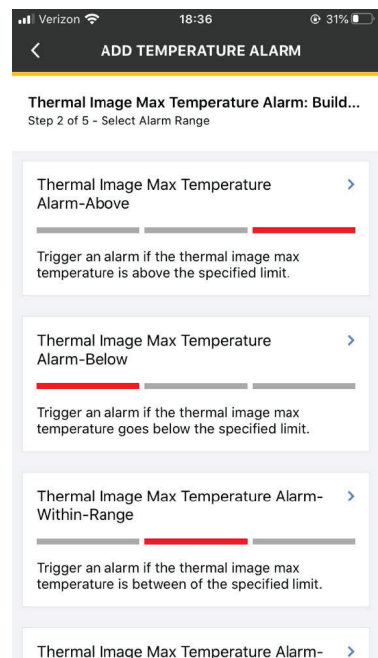


**Step 9:**

Enter the alarm threshold number. Press the 'Next' button to move onto the next screen.

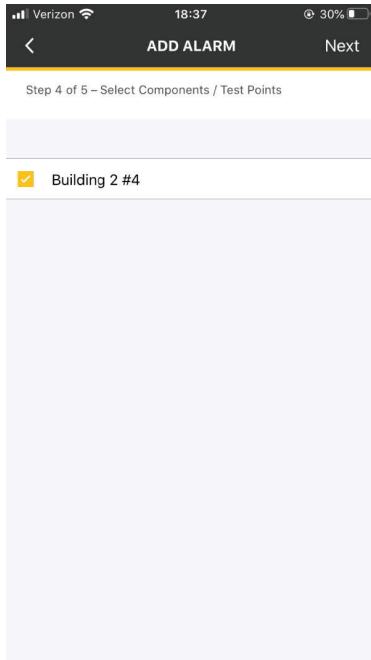


**Step 10:**

Select the overall asset or individual test point you would like to assign the alarm to. Press the 'Next' button to move onto the next screen.

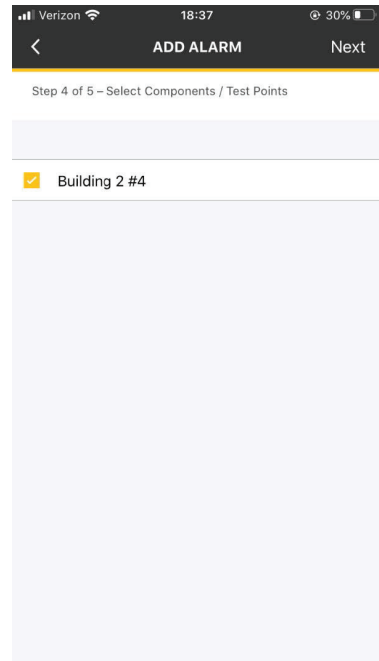

**Step 11:**

Alarms can be sent to your team members. Select who you would like the alarm notification to be sent to. Press the 'Save' button to move onto the next screen.

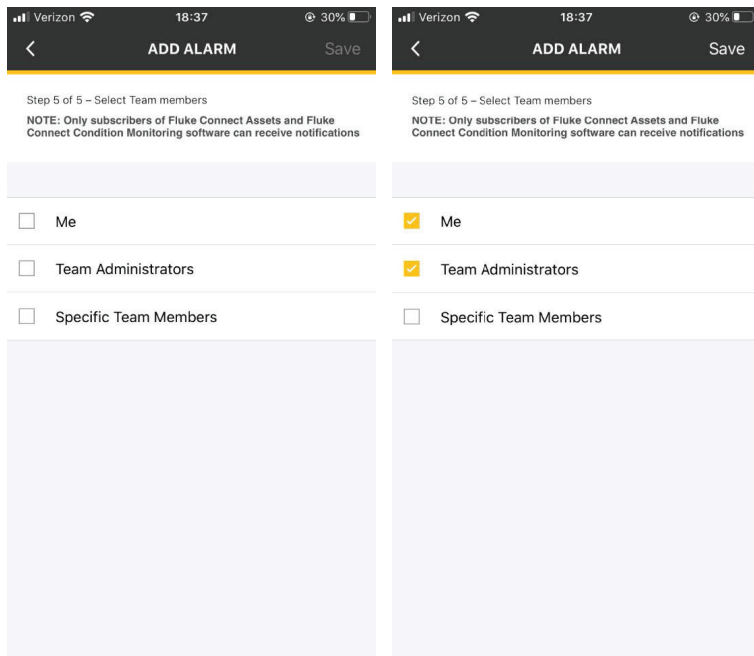

**Accelix. Connected Reliability.**

**Fluke Corporation**  
PO Box 9090, Everett, WA 98206 U.S.A.

**For more information call:**  
In the U.S.A. 856-810-2700  
In Europe +353 507 9741  
In UK +44 117 205 0408  
Email: support@accelix.com  
Web access: http://www.accelix.com

©2020 Fluke Corporation. 07/2020 6013632a-en

**Modification of this document is not permitted without written permission from Fluke Corporation.**